



**TOWN OF NEW TECUMSETH**

**WASTEWATER QUALITY MANAGEMENT SYSTEM**

**OPERATIONAL PLAN**

Alliston Wastewater Treatment and Collection  
Regional Wastewater Treatment and Collection  
Tottenham Wastewater Treatment and Collection

*Version Number – 03*

*Revised – May 20, 2022*

## CONTENTS

Element 1 – Quality Management System .....	4
Element 2 – Quality Management System Policy .....	5
Element 3 – Commitment and Endorsement .....	6
Element 4 – Quality Management System Representatives .....	7
Element 5 – Documents and Records Control .....	8
Element 6 – Wastewater System Process Description .....	9
Alliston Wastewater Treatment System .....	9
Wastewater Objective Parameter .....	9
Wastewater Treatment Description .....	9
Wastewater Collection System .....	9
Regional Wastewater Treatment System .....	11
Wastewater Objective Parameter .....	11
Wastewater Treatment Description .....	11
Wastewater Collection System .....	12
Tottenham Wastewater Treatment System .....	13
Wastewater Objective Parameter .....	13
Wastewater Treatment Description .....	13
Wastewater Collection System .....	14
Element 7 – Risk Assessment .....	15
Element 8 – Risk Assessment Outcomes .....	16
Element 9 – Organizational Structure, Roles, Responsibilities and Authorities .....	17
Organizational Structure .....	17
Operational Roles, Responsibilities and Authorities .....	18
Element 10 – Competencies .....	19
Satisfying Competencies .....	19
Element 11 – Personnel Coverage .....	20
Element 12 – Communications .....	21
Element 13 – Essential Supplies and Services .....	22
Element 14 – Review and Provision of Infrastructure and Resources .....	23
Element 15 – Infrastructure Maintenance, Rehabilitation and Renewal .....	24
Infrastructure Maintenance .....	24
Planned Maintenance .....	24
Unplanned Maintenance .....	25

Infrastructure Rehabilitation and Renewal .....25

Element 16 Sampling, Testing and Monitoring .....26

    Sampling and Testing.....26

    Monitoring.....26

        SCADA .....26

        Visual .....26

Element 17 Measurement & Recording Equipment Calibration & Maintenance .....27

Element 18 Emergency Management .....28

Element 19 Internal Audits .....29

Element 20 Management Review.....30

Element 21 Continual Improvement .....31

## ELEMENT 1 – QUALITY MANAGEMENT SYSTEM

A Quality Management System (QMS) can be defined as a set of policies, processes and procedures required for planning and execution in the core business area of an organization. A QMS integrates the various internal processes within the organization and intends to provide a process approach for day to day operations and project execution. A Quality Management System, enables an organization to identify, measure, control, and improve various core business processes that will ultimately lead to improved business performance.

The use of Quality Management Systems by modern industry has steadily increased over the last 30 years, since the development of the first ISO standard in 1986. Whether implemented voluntarily or as a requirement of suppliers to larger manufacturers, Quality Management has repeatedly proven beneficial in terms of accountability, quality control, efficiency, and productivity.

The Town of New Tecumseth Wastewater Quality Management System (WW-QMS) is documented in this Operational Plan as part of our efforts to ensure that a reliable treatment and collection system is provided to all customers served by the Town of New Tecumseth Wastewater Business Unit. The development and continual improvement of the plan will help ensure that all regulatory requirements are met and that consumers can be confident that the Wastewater Treatment System does not impact the natural environment in which they live.

This plan was developed to meet or exceed the Quality Management Standard, developed by the Ministry of Environment, Conservation and Parks, and is applied to the Town of New Tecumseth Wastewater System.

## ELEMENT 2 – QUALITY MANAGEMENT SYSTEM POLICY

The Municipality of the Town of New Tecumseth owns, maintains and operates the New Tecumseth Wastewater Collection and Treatment Systems. The Town of New Tecumseth is committed to:

- Complying with all applicable legislative and regulatory requirements to collect and treat wastewater
- Maintaining and continually improving of the Wastewater Quality Management System
- Protecting the natural environment through the use of affective wastewater treatment processes

The Municipality of the Town of New Tecumseth

March 13, 2017

### ELEMENT 3 – COMMITMENT AND ENDORSEMENT

The system owner, The Corporation of the Town of New Tecumseth, support the implementation, maintenance and continual improvement of the Wastewater Quality Management System for the Town of New Tecumseth Wastewater Systems, as documented in this Operational Plan. Endorsement by the Owner and Top Management acknowledges the need for and supports the provision of sufficient resources to maintain and continually improve the WW-QMS (QMS Procedure 01).

Endorsed by:

\_\_\_\_\_  
Rick Milne  
Mayor

\_\_\_\_\_  
Date

\_\_\_\_\_  
Blaine Parkin  
Chief Administrative Office

\_\_\_\_\_  
Date

\_\_\_\_\_  
Bruce Hoppe  
General Manager, Infrastructure & Development

\_\_\_\_\_  
Date

\_\_\_\_\_  
Chad Horan  
Director of Public Works

\_\_\_\_\_  
Date

## ELEMENT 4 – QUALITY MANAGEMENT SYSTEM REPRESENTATIVES

The QMS Coordinator will be the WW-QMS representative. In their absence, the Compliance Coordinator in conjunction with the Manager of Water and Wastewater will carry out the WW-QMS representative's responsibilities.

Following are the responsibilities of the WW-QMS representative:

- Provides all staff with necessary technical and administrative consultation related to WW-QMS document preparation and implementation.
- Ensures that processes and procedures needed for the WW-QMS are established and maintained
- Annual report WW-QMS results to Senior level of Management as well as any need for improvement
- Implements and oversees the WW-QMS document and record control procedure
- Reviews and approves WW-QMS documentation before the management review and approval of all documents
- Coordinates and acts as liaison for internal and external audits
- Promotes the awareness of the WW-QMS throughout the Wastewater Business Unit of the Public Works Department and reports WW-QMS results to Wastewater staff
- Performs staff and supplier WW-QMS communication and training
- Ensures that personnel are aware of all applicable legislative and regulatory requirements that pertain to their duties for the Town of New Tecumseth Wastewater Systems
- Ensures the current version of all documents required by the WW-QMS are in use at all times and updates published

## ELEMENT 5 – DOCUMENTS AND RECORDS CONTROL

The town has developed a Procedure for Control of Documents and Records (QMS Procedure 02) This procedure describes how documents and records are controlled within the QMS. The Documents and Records contained within the QMS are recorded on the Document and Record Control Table (Appendix A).



## ELEMENT 6 – WASTEWATER SYSTEM PROCESS DESCRIPTION

### ALLISTON WASTEWATER TREATMENT SYSTEM

The Alliston Wastewater Treatment Plant is owned and operated by the Corporation of the Town of New Tecumseth. The Collection system is comprised of residential, industrial, commercial, and institutional. An overview of the system located in Appendix B.

### WASTEWATER OBJECTIVE PARAMETER

The following table is a summary of the water quality parameters defined by the facilities Environment Certificate of Approval established by the Ministry of Environment Conservation and Parks (MECP). Treatment processes are continually monitored to achieve the following effluent limits.

Effluent Parameters	5,681 m <sup>3</sup> /day		
	Objectives	Limits	
cBOD	10 mg/L	15 mg/L	
Suspended Solids	10 mg/L	15 mg/L	
Total Phosphorous	0.3 mg/L	0.5 mg/L	
Ammonia	April 1 – Nov. 30 Dec. 1 – March 31	0.8 mg/L 2.0 mg/L	1.0 mg/L 3.0 mg/L
E.Coli	80 cfu/100mL	80 cfu/100mL	

### WASTEWATER TREATMENT DESCRIPTION

The Alliston Wastewater Treatment Plant utilizes an extended aeration process that includes secondary and tertiary treatment. Wastewater comes into the plant by gravity to the headworks building and flows through a bar screen before traveling through a grit removal system. The grit falls into a hazardous waste storage bin and transported to the landfill. Once the grit is removed the wastewater flows through a splitter chamber to divert flows into the secondary treatment. Secondary treatment consists of two separate treatment trains comprised of aeration tanks that are equipped with fine bubble air diffuser system and clarifiers to settle out the solids. The solids, known as return activated sludge (RAS), is pumped back to the aeration tanks to be reused in the treatment process again. The clarified wastewater, known as effluent, moves to the tertiary treatment to achieve effluent limits set out in the Certificate of Approval. Tertiary treatment uses a dual media filter to remove the fine particles before passing through an open channel UV disinfection system. The final effluent is discharged into the receiving water body, Boyne River.

Excess activated sludge, known as waste activated sludge (WAS), is pumped to aerobic digesters for storage that are equipped with a coarse bubble diffuser system. WAS is stored in the aerobic digester before being transferred to the Regional Wastewater Treatment Plant's biosolid tanks for disposal.

### WASTEWATER COLLECTION SYSTEM

The Alliston Wastewater Treatment Plant receives wastewater collected from the north end of Alliston consisting of 28.3km of both gravity and pressurized sanitary pipes. The collection area is comprised of four wastewater pumping stations; Oak Swage Pumping Stations (SPS), Fletcher SPS, J.W. Taylor SPS, and Maple Lane SPS. Church Street SPS has two forcemains one leading to the Alliston WWTP and another

Regional WWTP. Church St. Sewage Pumping Stations directs wastewater primarily to the Regional WWTP with a secondary forcemain to the Alliston WWTP as a backup. The Alliston WWTP receives all the wastewater through a gravity feed system.

## REGIONAL WASTEWATER TREATMENT SYSTEM

The Regional Wastewater Treatment Plant is owned and operated by the Corporation of the Town of New Tecumseth. The Collection system is comprised of residential, industrial, commercial and institutional. An overview of the system is located in Appendix C.

### WASTEWATER OBJECTIVE PARAMETER

The following table is a summary of the water quality parameters defined by the facilities Environment Certificate of Approval established by the Ministry of Environment, Conservation and Parks (MECP). Treatment processes are continually monitored to achieve the following effluent limits.

Effluent Parameters	7,595 m <sup>3</sup> /day		11,400 m <sup>3</sup> /day	
	Objectives	Limits	Objectives	Limits
cBOD	10 mg/L	15 mg/L	6.7 mg/L	10 mg/L
Suspended Solids	10 mg/L	15 mg/L	6.7 mg/L	10 mg/L
Total Phosphorous	0.10 mg/L	0.15 mg/L	0.07 mg/L	0.10 mg/L
Ammonia	Dec 1 – April 30	0.35 mg/L	0.5 mg/L	0.35 mg/L
	May 1 – Nov 30	3.0 mg/L	3.3 mg/L	3.0 mg/L
E.Coli	100 cfu/100mL	200 cfu/100mL	100 cfu/100mL	200 cfu/100mL

### WASTEWATER TREATMENT DESCRIPTION

The Regional Wastewater Treatment Plant utilizes an extended aeration process that includes secondary and tertiary treatment. Wastewater flows through several wastewater pumping stations within the Town of Alliston and Beeton and are brought to the headworks of the Regional Wastewater Treatment Plant. The Influent flows through 6mm fine screen strainer that are capable of handling peak flows of 30,000m<sup>3</sup>/day. After the strainer, the wastewater travels to the grit removal system. The grit removal system at the Regional WWTP consists of vortex grit chamber which utilizes centrifugal force and gravity to separate the grit from the wastewater flow. Grit moves through a grit dewatering screw classifier that separates the grit from the grit/water mixture. The grit falls into a hazardous waste storage bin and transported to the landfill. The wastewater collected from the dewatering process moves to the splitter chamber where it is mixed with RAS before being returned to the aeration tanks. Wastewater moves into the secondary treatment and is divided into the two treatment trains comprised of aeration tanks that are equipped with fine bubble air diffuser system and clarifiers to settle out the solids. The RAS is pumped back to the aeration tanks to be reused in the treatment process again. The clarified water moves to the tertiary treatment where an ACTIFLO process is used to achieve effluent limits set out in the Certificate of Approval. ACTIFLO uses a coagulant, in the form of Alum, as well as polymer, is added and mixed. Silica Sand is added as a binding agent to assist the fine particles to settle. After the water leaves the ACTIFLO it flows through the DynaSand Filters for further treatment to enhance the quality of the effluent before entering an open channel UV disinfection system. The final effluent travels into the post aeration tank to maintain dissolved oxygen concentration before discharging into the receiving water body, Nottawasaga River.

Waste activated sludge is pumped to the aerobic digesters for storage that are equipped with a coarse bubble diffuser system. WAS is pumped to the sludge thickening tank where decant pumps bring the supernate to the aeration tanks. Waste activated sludge is then transferred to the biosolid tanks, where it is stored along with the WAS from the Alliston WWTP. Biosolids are loaded onto tanker trucks to be spread on agricultural land.

The Regional Wastewater Treatment Plant receives and processing septage from approved haulers. The septage is pumped from the truck and processed through a rock trap assembly to remove all non-organic materials before proceeding to a grinder. The septage is then stored in two holding tanks that equalize the septage before pumping to the treatment process at a controlled rate. The equalization tanks prevent the treatment process from being over loaded.

#### WASTEWATER COLLECTION SYSTEM

The Regional Wastewater Treatment Plant collects wastewater from south end of Alliston and Beeton consisting of 99.2km of both gravity and pressurized sanitary pipes. The collection area is comprised of five wastewater pumping stations; Church Street SPS, Lilly Street SPS, Industrial Parkway SPS, Lorne Thomas SPS and Cauthers SPS. The Church Street Swage Pumping Stations has two forcemains one leading to the Alliston WWTP and another to the Regional WWTP. Church St. SPS directs wastewater primarily to the Regional WWTP with a small predetermined amount of wastewater directed to the Alliston WWTP as part of an odour control program within the collection system.

## TOTTENHAM WASTEWATER TREATMENT SYSTEM

The Tottenham Wastewater Collection and Treatment System is owned and operated by the Corporation of the Town of New Tecumseth. The Collection system is comprised of residential, industrial, commercial, and institutional. An overview of the system located in Appendix D.

### WASTEWATER OBJECTIVE PARAMETER

The following table is a summary of the water quality parameters defined by the facilities Environment Certificate of Approval established by the Ministry of Environment, Conservation and Parks (MECP). Treatment processes are continually monitored to achieve the following effluent limits

Effluent Parameters	4,082 m <sup>3</sup> /day		
	Objectives	Limits	
cBOD	5 mg/L	6 mg/L	
Suspended Solids	10 mg/L	15 mg/L	
Total Phosphorous	0.07mg/L	0.10mg/L	
Ammonia	May – September	0.35 mg/L	0.5 mg/L
	April and October	1.0 mg/L	1.2 mg/L
	November – March	3.0 mg/L	3.3 mg/L
E.Coli	50 cfu/100mL	80 cfu/100mL	

### WASTEWATER TREATMENT DESCRIPTION

The Tottenham Wastewater Treatment Plant utilizes an extended aeration process that includes secondary and tertiary treatment. Wastewater comes into the plant at the headworks building where it flows through 6mm fine screens equipped with screen washer/compactors and a vortex grit separator which utilizes centrifugal force and gravity to separate the grit from the wastewater. The grit falls into a hazardous waste storage bin and transported to the landfill. Once the grit is removed the water flows into the secondary treatment consisting of two treatment trains comprised of aeration tanks that are equipped with fine bubble air diffusers system and clarifiers to settle out the solids. The RAS is pumped back to the aeration tanks to be reused in the treatment process again. The clarified water moves to tertiary treatment where an ACTIFLO process is used to achieve effluent limits set out in the Certificate of Approval. ACTIFLO uses a coagulant, in the form of Alum, as well as polymer, is added and mixed. Silica Sand is added as a binding agent to assist the fine particles to settle. After the water leaves the ACTIFLO it flows through a shallow-bed sand media filter to enhance the quality of the effluent before entering an open channel UV disinfection system. The final effluent is discharged into the receiving water body, Beeton Creek.

Waste activated sludge is pumped to the aerobic digester for storage that are equipped with a coarse bubble diffuser system and decant pumps to bring the supernate to the aeration tanks. Waste activated sludge from the aerobic digester is transferred to the sludge storage lagoon, where it can be loaded onto tanker trucks to be spread on agricultural land. The sludge storage lagoon is equipped with decant pumps so the supernate can be brought back to the headworks of the plant

During high flow volumes, such as a storm event or snow melt, water can be diverted to the effluent storage lagoons and later pumped back to the headworks of the plant for treatment. Effluent storage lagoon 2 is gravity fed into lagoon 3, a valve can be opened to have lagoon 2 water flow into lagoon 3. Contents of lagoon 2 & 3 can be independently pumped back to the headworks utilizing a common forcemain.

#### WASTEWATER COLLECTION SYSTEM

The Tottenham Wastewater Treatment Plant collects wastewater from the Village of Tottenham consisting of 28.3km of both gravity and pressurized sanitary pipes. The collection area is comprised of four wastewater pumping stations; Nolan Road SPS, Mill St SPS, Pierce Place SPS and Industrial Road SPS.

## ELEMENT 7 – RISK ASSESSMENT

The Town of New Tecumseth established, implemented and maintains a Risk Assessment Procedure (QMS Procedure 03) to determine potential hazards and critical control points within the Town's Wastewater Collection and Treatment Systems. Hazards and Hazardous Events were identified and documented in the Risk Assessment Outcomes Table (Form 07-01). Each hazard is assessed with consideration of Likelihood, Severity and Detectability in order to determine its final Risk Rating. From the Risk Rating, it can be determined where Critical Control Points (CCP) are and what contingency plans are needed to mitigate the hazard.

## ELEMENT 8 – RISK ASSESSMENT OUTCOMES


The Risk Assessment Outcomes for the Alliston, Regional and Tottenham Wastewater Treatment Plants and collection systems can be found in Appendix E - G respectively. Control Limits have been established for the Critical Control Points identified in the Risk Assessment Outcomes Table and are within the regulatory limits set by the Ministry of Environment, Conservation and Parks (MECP). The Control Limits act as a warning that adjustments to the treatment process may be required to prevent an adverse condition incident.



## ELEMENT 9 – ORGANIZATIONAL STRUCTURE, ROLES, RESPONSIBILITIES AND AUTHORITIES

### ORGANIZATIONAL STRUCTURE

Organizational Structure of the Wastewater Department are shown as following:

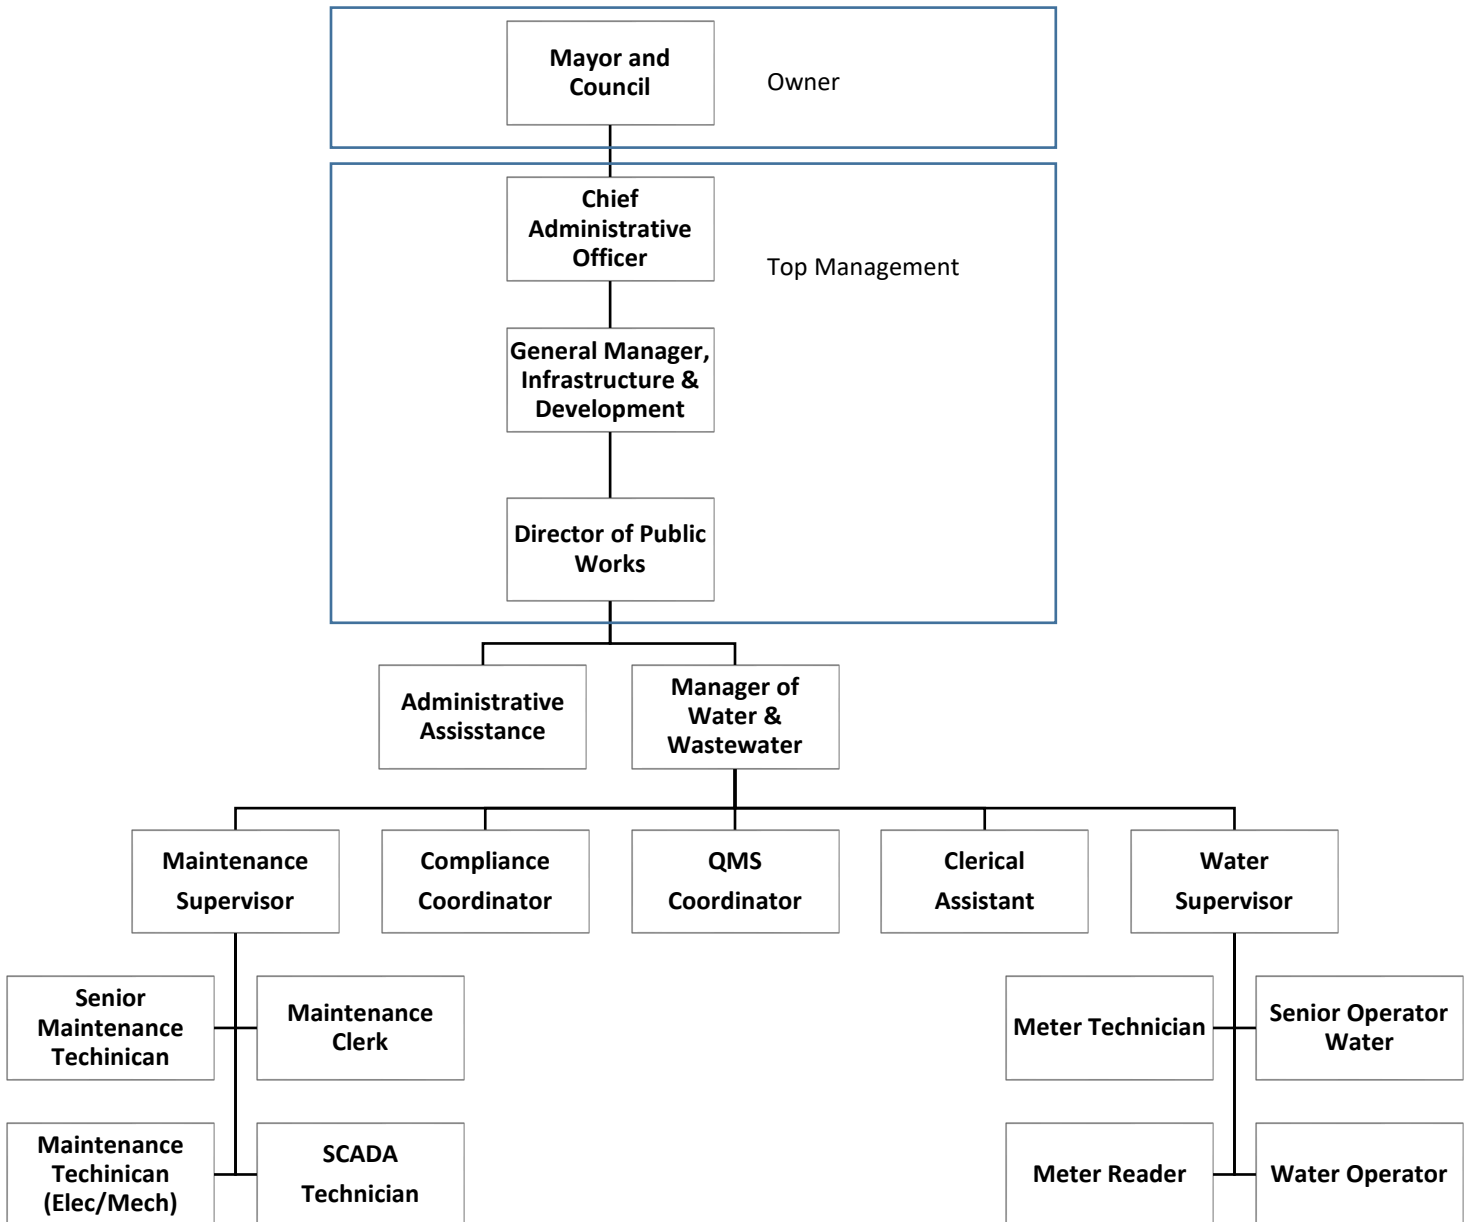

## **OPERATIONAL ROLES, RESPONSIBILITIES AND AUTHORITIES**

The operational roles, responsibilities and authorities of individuals who are responsible for the Town's Wastewater Treatment System under the WW-QMS are described in Appendix H.

## ELEMENT 10 – COMPETENCIES

The Ministry of the Environment and Climate Change has classified the Town of New Tecumseth's Wastewater Systems as a Class II Treatment and Class II Collection System. The Competency requirement table in Appendix I identifies the competencies required of the Town of New Tecumseth staff whose performance may have direct impact on the Wastewater Systems.

### SATISFYING COMPETENCIES

The Town of New Tecumseth may administer certain tests, conduct interviews, and verify references and/or request specific documentation as part of the hiring process in order to verify skills, experience and knowledge. All new employees outlined above must provide evidence of certification and other competency requirements.

All new employees will undergo training conducted and documented by appropriate staff, including a review of the Operations Manual and Contingency / Emergency plans for the Wastewater Systems, a review of the WW-QMS Operational Plan, and on-the-job training.

Annual training is provided to ensure that certified operational staff meet or exceed minimum standards for annual training hours and continuing education hours as established in O.Reg. 129/04 to maintain operator certification. In order to meet the ongoing changes to technology, software and the requirements of O.Reg. 129/04, staff will receive training in accordance with the Town's Policy on Continuing Education.

All records of training and certificates are maintained at the Public Works office according to the Document and Record Control procedure as proof that the required training has been successfully completed. Using the Public Works Training Matrix, the Wastewater Supervisor in conjunction with the Compliance Coordinator recommends the required training for staff. Operators are responsible for completing required training and for renewing their certificates. The Wastewater Supervisor and Compliance Coordinator ensure all certificates are current. All operator certificates are posted at Alliston, Regional and Tottenham Wastewater Treatment Plants.

## ELEMENT 11 – PERSONNEL COVERAGE

A procedure for Personal Coverage (QMS Procedure 04) has been developed for the Town of New Tecumseth Wastewater Systems. The procedure outlines the normal working hours for the operation staff as well as after hours and holiday coverage.

## ELEMENT 12 – COMMUNICATIONS

A procedure for Communication (QMS Procedure 05) has been developed for the Town of New Tecumseth Wastewater System. The procedure describes how the Town of New Tecumseth communicates the WW-QMS between the Town Council and its employees, suppliers and the public.

## ELEMENT 13 – ESSENTIAL SUPPLIES AND SERVICES

This procedure identifies the supplies and services deemed essential to wastewater collection and treatment systems (QMS Procedure 06). The procedure identifies how to ensure the quality of essential supplies and services that can affect the wastewater process.

The products and services listed in Appendix J are deemed to be essential to the wastewater systems. Each of these products or services is available from more than one source that is approved by the Wastewater Business Unit. This list is reviewed annually by the Wastewater Supervisor to ensure that it is current and up to date.

All essential products and services are purchased under the Town's Procurement of Good and Services Policy.

Supplies are verified against the order requisition when received. Proof of product must be provided to the Wastewater Supervisor or designate upon delivery prior to unloading.

## ELEMENT 14 – REVIEW AND PROVISION OF INFRASTRUCTURE AND RESOURCES

The Town's annual Infrastructure Review ensures periodic evaluation of the condition and capacity of infrastructure components. The results of the evaluation are used to prioritize future resource allocations.

The Manager of Water & Wastewater, in consultation with the General Manager of Infrastructure and Development, The Director of Engineering, and the Director of Public Works, assists with the preparation and the infrastructure Review report by considering previous infrastructure reviews, input from staff, MECP Compliance Inspection Reports, Risk Assessment Outcomes Tables, Flow data trends and maintenance records to determine priority needs.

The infrastructure review is included as a section in the Wastewater QMS Annual report to Council. The infrastructure review is revisited and revised if deemed necessary by management during the preparation of the annual budget.

## ELEMENT 15 – INFRASTRUCTURE MAINTENANCE, REHABILITATION AND RENEWAL

Once per year, the Manager of Water and Wastewater in conjunction with the Engineering Department will prepare a summary of the infrastructure maintenance, rehabilitation and renewal programs and specifically look at unplanned maintenance work to determine if additional planned maintenance is required. This summary is included as a section of the Infrastructure Review Report and will be communicated to the Council as part of the Wastewater QMS Report.

### INFRASTRUCTURE MAINTENANCE

Maintenance activities may significantly impact the efficiency of the treatment and collection process. Pre-planning and a documented systematic approach to addressing maintenance activities, where possible, can minimize this impact.

In order to monitor the effectiveness of the Town's maintenance program, a summarization of the maintenance activities will be reviewed for the year. The Maintenance summary is reviewed at the Element 15 meeting and concerns are identified and discussed with the meeting attendees. The summaries and any comments from the review are documented in the meeting minutes and filed in accordance with the Document and Record Control procedure.

The following key maintenance indicators might be considered while assessing the effectiveness of the Town's maintenance program:

- The cost for supplies and the number of repair hours
- The number of completed work orders or maintenance activities in a given time period.
- The number or percent of overdue planned maintenance activities
- The number and frequency of unplanned maintenance activities

### PLANNED MAINTENANCE

Planned Maintenance is defined as any variety of scheduled maintenance, be it preventative or predictive in nature. The Wastewater and Maintenance staff perform planned maintenance on a regular schedule that is reviewed and updated according to needs and priorities. Planned maintenance is scheduled and communicated to staff by issuance of work orders through Computerized Maintenance Management System (CMMS). Completed work orders are reviewed and signed by the appropriate Supervisor or designate.

Scheduled tasks on Machinery and Equipment are typically defined by manufacturer's literature when available and revised (or created) as needed according to operator experience/observations. Other planned maintenance includes but not limited to, bi-annual sewer flushing, wet well cleaning, clarifier cleaning, and UV bulb maintenance.

Maintenance and construction activities are primarily performed by Public Works staff with construction components contracted on an as required basis. Subcontracted work is performed in accordance with the



Town of New Tecumseth policies and procedures. The appropriate Supervisor or designate shall ensure that contracted work is monitored as required.

Once the maintenance work is completed, the appropriate staff (i.e., operational, maintenance or contractor) shall describe the work details on the face of the work order and shall obtain the Supervisor's approval before the work order is returned to the Maintenance Clerk to be filed according to the Document and Record Control Procedure and/or stored in the Computerized Maintenance Management System (CMMS).

### UNPLANNED MAINTENANCE

Typical unplanned maintenance includes blocked sewer mains or a break in the sanitary mains. Town staff work to complete the unplanned maintenance and when there are not enough internal resources available then the Wastewater Supervisor or designate contracts this work. A list of acceptable contractors is contained within the Essential Supplies and Services list. A certified operator must conduct or be present during all operational work unless the maintenance is being performed in isolation of the wastewater treatment process.

Unplanned machinery and equipment maintenance tasks result from mechanical or electrical malfunction and/or failure. The Maintenance Supervisor or designate is responsible to ensure all the equipment associated with the wastewater system is appropriately maintained. The Maintenance Supervisor or designate has the authority to contract unplanned maintenance work to a qualified contractor listed in the Essential Supplies and Services Table. All unplanned maintenance work shall be recorded on a work order and forwarded to the Maintenance Supervisor for approval and then sent to the Maintenance Clerk to be filed in accordance with the Document and Record Control procedure and/or stored in the CMMS.

### INFRASTRUCTURE REHABILITATION AND RENEWAL

Asset Management compiles an infrastructure rehabilitation and renewal schedule considering all available information such as age, condition, risk, and level of service. Staff suggestions, consumer complaints, and water quality trends are also taken into consideration when determining priority projects. The Public Works Department, Asset Management Business Unit and the Engineering Department review the priority projects in relation to a projected 1 year, 5 year and/or 10-year plans. Assets which have been identified as needing a form of rehabilitation or renewal are included in the Annual Business Planning process (budget) that is utilized to drive the decision make process with the Owner. Detailed estimates are prepared to establish how much funding will be required to complete the recommended projects. The capital requirements are then submitted to Senior Management, Executive Management and the Owner for approval.

## ELEMENT 16 SAMPLING, TESTING AND MONITORING

### SAMPLING AND TESTING

The Town of New Tecumseth Wastewater Business Unit sampling program is based on the requirements set out in the Environmental Compliance Approval.

Analytical results are acquired from in-house analyses as well as from a selected accredited laboratory. A competent certified operator performs all in house sampling, which includes phosphorus, ammonia and suspended solids testing. In house laboratory data are entered into the In-plant test results log book. In addition to the test conducted by operators, samples are collected and submitted weekly to an accredited laboratory for testing. Test results from the accredited lab are emailed to the Wastewater Supervisor and the Compliance Coordinator for review and filing.

Analytical results are available to members of the public upon request from the Public Works office. Analytical results are summarized and presented to Top Management at the element 20 Management Review meeting.

### MONITORING

#### SCADA

The SCADA system monitors and controls the Wastewater treatment including;

- Wet well levels, pumps, flow meters, analyzers, chemical feed pumps, and system pressure etc. Detailed information can be obtained from the SCADA manual.
- The operator has the capability to adjust processes affecting final effluent water quality based upon the information and data provided by SCADA.
- Any adjustment made to process parameters are recorded in the Daily Log and recorded by SCADA.
- All parameters related to compliance are trended by the SCADA system.
- Currently WIN 911 is used for paging alarms at the following SCADA server locations:
  - Alliston Wastewater Treatment Plant
  - Regional Wastewater Treatment Plant
  - Tottenham Wastewater Treatment Plant

#### VISUAL

- The operator conducts a visual inspection ('rounds') of the facilities during the weekday. Please refer to the Operational Checks procedures within the Town's Procedures for instruction on the inspection of each facility.
- Results are recorded in the Daily logbooks at each facility.
- In-house laboratory analysis is performed throughout the week at various stages of treatment. Please refer to the Operational Checks procedures with the Town's Procedure for instruction on the laboratory analysis at each facility.
- Equipment and building conditions, if deficiencies, shall be noted in the daily log and reported to the Wastewater Supervisor or designate.

## **ELEMENT 17 MEASUREMENT & RECORDING EQUIPMENT CALIBRATION & MAINTENANCE**

A qualified contractor is obtained to calibrate the flow meters, Hach analyzers, and gas detectors once a year. Records of all calibrations are retained at the Public Works office according to the Records and Control Procedure. Contractors qualified for performing calibrations are listed on the Essential Supplies and Services list.

## ELEMENT 18 EMERGENCY MANAGEMENT

The Emergency Management Procedure (QMS Procedure 07) provides conditions at the Town of New Tecumseth Wastewater Systems that are considered to be a potential emergency based on the Risk Assessment and general observations and the required steps to respond to a major emergency involving the wastewater system are included

## ELEMENT 19 INTERNAL AUDITS

Internal audits are conducted to ensure that the WW-QMS conforms to the requirements of the Town of New Tecumseth Wastewater Operational Plan. The internal audit will also use the requirements set out in the Ontario Drinking Water Quality Standard as a guide for Wastewater QMS audits. This standard developed by the Provincial Government was used to create the Town's Wastewater QMS. These requirements include ensuring that the WW-QMS has been effectively implemented and properly maintained. The Town of New Tecumseth has documented a procedure for internal audits (QMS Procedure 08).

## ELEMENT 20 MANAGEMENT REVIEW

A Management Review is used to evaluate the continuous suitability, adequacy, and effectiveness of the WW-QMS. A procedure for Management Review (QMS Procedure 09) has been established by the Town of New Tecumseth and is performed on an annual basis. It is recommended that after Management Review and along with the Wastewater Quality Management Report that Council Re-Endorse the Wastewater Operational Plan (QMS Procedure 01).

## ELEMENT 21 CONTINUAL IMPROVEMENT

The Town of New Tecumseth will establish and maintain a Wastewater Quality Management System by regular reviews, improved and upgraded by management and employees involved in the treatment of municipal wastewater.

When appropriate, the Town of New Tecumseth will modify / update adjust processes and procedures (while remaining in compliance with MECP regulations) to improve operations and customer satisfaction (QMS Procedure 10).